



- Connects the Remote Process Interface to the control system/PLC/PC via MODBUS Plus
- Couples the internal CAN bus to the external MODBUS Plus
- Device installation permissible in zone 2
- For the connection of max. 16 RPI devices
- Master function for the internal CAN bus
- External bus: MODBUS Plus
- External baud rate 1 MBd
- Standard interface RS 485
- Separate RS 232 connection on front side for system configuration, also directed to terminals for creating a subordinate monitoring system
- 24 V DC nominal supply voltage
- Redundancy of the gateways and external buses not possible
- EMC acc. to NAMUR NE 21


**Function**

The KSD2-GW-MPL.B translates the protocols of the internal CAN Bus into the Modbus-plus protocols of the external Bus system and vice versa. Up to 16 devices can be connected to a Gateway via the Power Rail. The device addresses for the internal bus are between 3 and 18 (inclusive).

**Application**

- Connection of the RPI with control system/PLC/PC via MODBUS Plus.
- Configuration interface for the RPI devices.


**Connection**

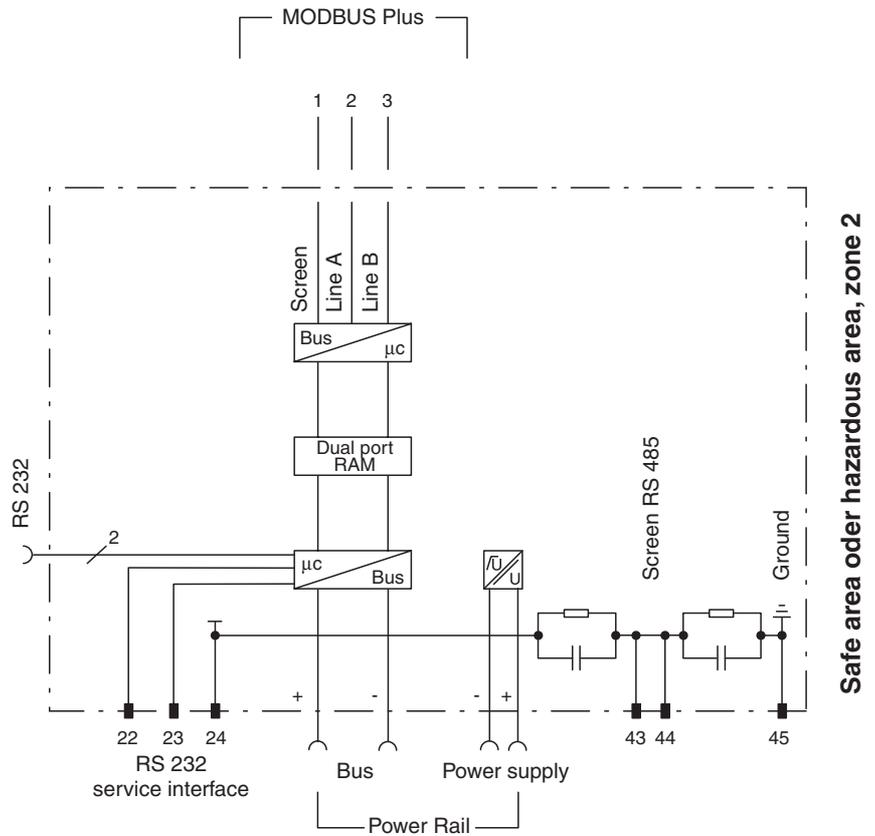

**Composition**

**Front View**

Housing type G  
(see system description)

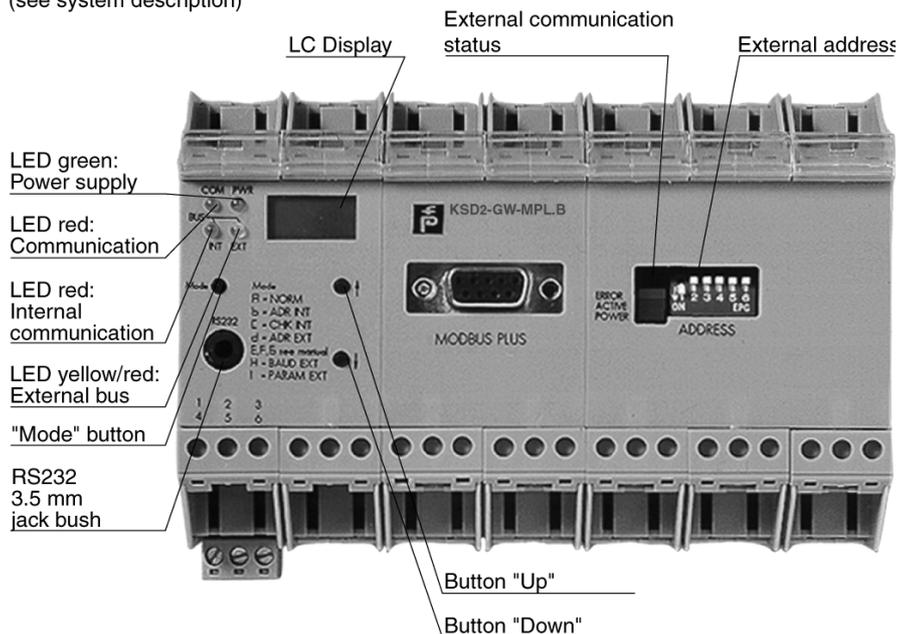

Release date 2006-12-04 14:41 Date of issue 2006-12-04 097590\_ENG.xml

<b>Supply</b>	
Connection	Power Rail
Rated voltage	20 ... 30 V DC
Ripple	< 10 %
Power consumption	4.8 W
<b>Internal bus</b>	
Connection	Power Rail
Interface	CAN protocol via Power Rail bus with up to 16 units
Cycle time	1 device 25 ms 16 devices with discrete input 29 ms 16 devices with discrete output 33 ms 16 devices with analogue input 31 ms 16 devices with analogue output 35 ms
<b>External bus</b>	
Connection	Sub-D socket, 9-pin
Interface	MODBUS Plus, RS 485 interface
<b>Service interface</b>	
Connection	terminals 22, 23, 24 and jack bush
Interface	RS 232
<b>Electrical isolation</b>	
Internal/external bus	basic insulation acc. to DIN EN 50178, rated insulation voltage 50 V <sub>eff</sub> AC
Internal bus/power supply	not available
External bus/power supply	basic insulation acc. to DIN EN 50178, rated insulation voltage 50 V <sub>eff</sub> AC
Service interface/internal bus	basic insulation acc. to DIN EN 50178, rated insulation voltage 50 V <sub>eff</sub> AC
Service interface/external bus	basic insulation acc. to DIN EN 50178, rated insulation voltage 50 V <sub>eff</sub> AC
Service interface/supply	basic insulation acc. to DIN EN 50178, rated insulation voltage 50 V <sub>eff</sub> AC
<b>Directive conformity</b>	
Electromagnetic compatibility	
Directive 89/336/EC	EN 61326
<b>Standard conformity</b>	
Electrical isolation	EN 50178
Protection degree	IEC 60529
<b>Ambient conditions</b>	
Ambient temperature	-20 ... 60 °C (253 ... 333 K)
<b>Mechanical specifications</b>	
Protection degree	IP20
Mass	approx. 505 g
<b>Data for application in conjunction with hazardous areas</b>	
Statement of conformity	TÜV 00 ATEX 1617 X (observe statement of conformity)
Group, category, type of protection, temperature classification	⊕ II 3G EEx nA II T4

**Supplementary information**

EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity and instructions have to be observed. For information see [www.pepperl-fuchs.com](http://www.pepperl-fuchs.com).

**Notes**

**Operation**

The configuration, parameterization, addressing, operation and fault detection is performed by means of PC and the Human Machine Interface via RS 232 interface. Limited operation without a PC is possible with the control elements of the Gateway and the devices.

**Operating components**

Jacks for the connection of a PC across K-ADP2 adapter for the configuration and parameterization of the system. The PC may alternatively be connected to plug-in screw terminals 22, 23, 24 (43, 44, 45), in case, e. g. that a PC-based separate measured value monitor level is to be installed. The jack on the front panel and the screw terminals 22, 23, 24 may not be used simultaneously.